MINIMUM SPACING BETWEEN SUPPORTS:

CONDUIT	1/2" THRU 1-1/4"	3'
EMT OR	1-1/2" THRU 2"	8'
SCHED 40	2-1/2" AND UP	10'
	+ 2' FROM EACH TURN	

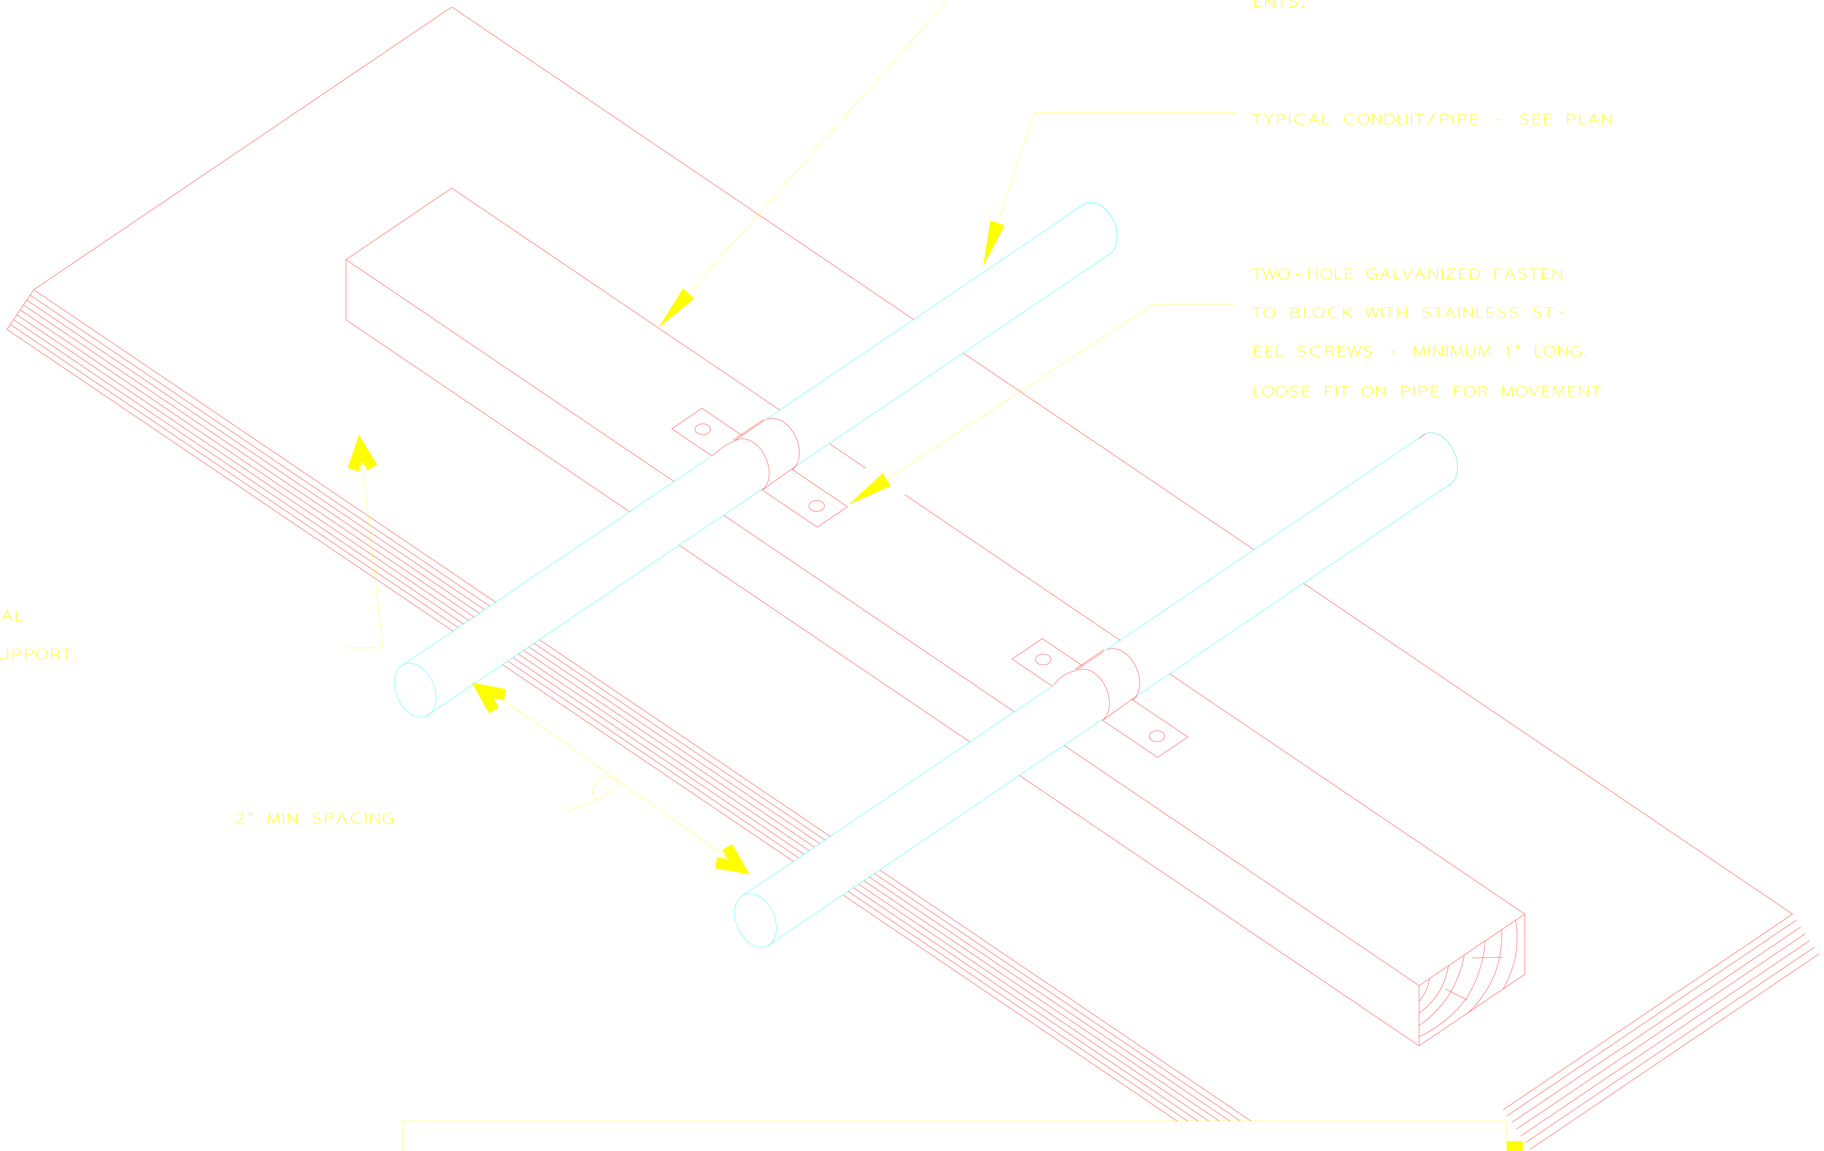

NOTE:

IF CONDUIT PIPING LAYOUT IS NOT SHOWN, GROUP CONDUIT/PIPE ROUTE FOR MINIMUM SUPPORTS ON RF. COORDINATE WITH ALL TRADES.

P13

CONDUIT / PIPE SUPPORT

NOT TO SCALE